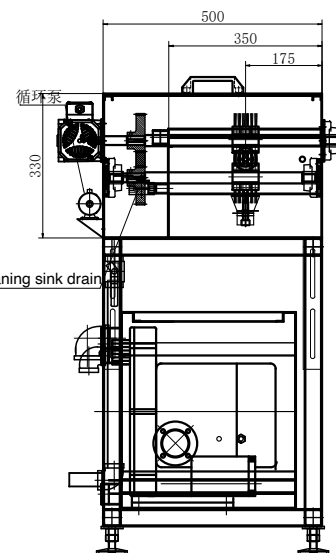
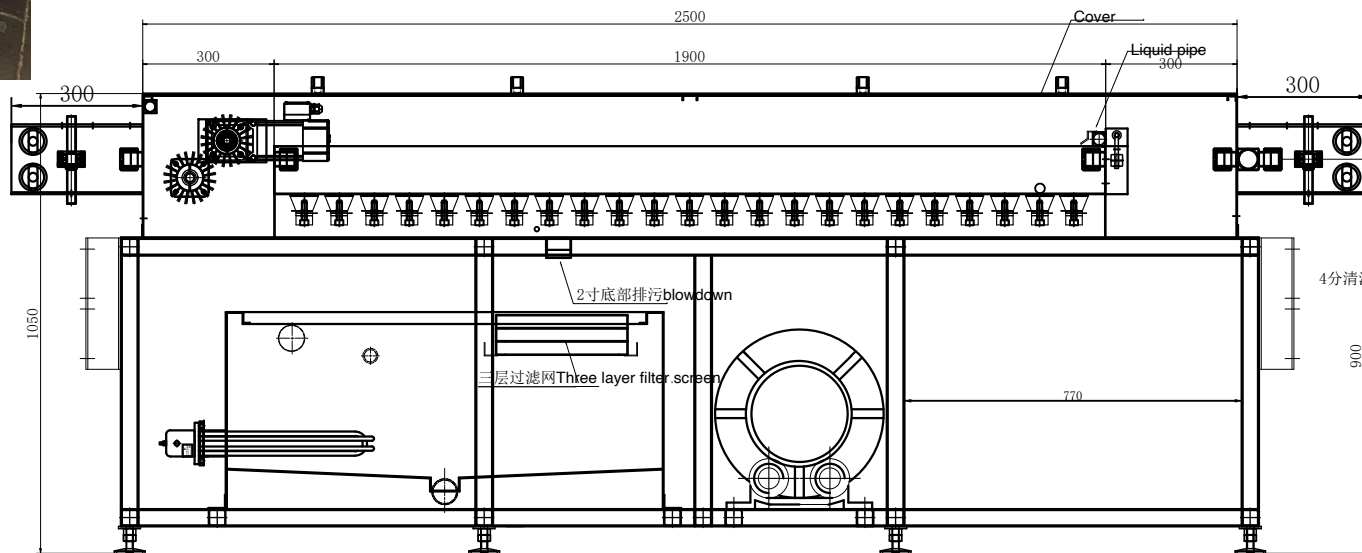


Technical requirements:

1. Dimensions: 2500 × 500 × 1050mm;
2. The tank body is made of 304 2.5mm plate;
3. Ultrasonic power: 2100W, ultrasonic frequency: 25KHZ;

Ultrasound is controlled in two groups;

Cleaning and draining of the liquid storage tank: 2 inches;
7. The liquid storage tank is equipped with a liquid level float switch, which automatically replenishes the liquid;

8. Vibration board output line 3M;

9. Blow dry air pump 2.2KW;

4. Ultrasonic heating power: 6000W per unit;
5. Ultrasonic circulating small pump: 95W;
6. Ultrasonic cleaning and sewage discharge: 4 points;

未注公差尺寸等级			
基本尺寸		公差等级	
大于	至	IT12	IT14
		+0.1	+0.2



设计		数量	
审核		材质	SUS 304
核准		项目编号	
图号		生产编号	20250517-2
机型			